



GAMMA series

16 functions

16 time ranges

Connection of remote potentiometer possible

Supply voltage selectable via power modules

2 change-over contacts

Width 22.5mm

Industrial design



Technical data

1. Functions

1 delayed contact (terminals 15-16-18) and

1 instantaneous contact (terminals 25-26-28)

E11	ON delay
R11	OFF delay with control contact
Es11	ON delay with control contact
Wu11	Single shot leading edge voltage controlled
Ws11	Single shot leading edge with control contact
Wa11	Single shot trailing edge with control contact
Bi11	Flasher pulse first
Bp11	Flasher pause first

2 delayed contacts

E20	ON delay
R20	OFF delay with control contact
Es20	ON delay with control contact
Wu20	Single shot leading edge voltage controlled
Ws20	Single shot leading edge with control contact
Wa20	Single shot trailing edge with control contact
Bi20	Flasher pulse first
Bp20	Flasher pause first

2. Time ranges

Time range	Adjustment range	
1s	50ms	1s
3s	150ms	3s
10s	500ms	10s
30s	1500ms	30s
1min	3s	1min
3min	9s	3min
10min	30s	10min
30min	90s	30min
1h	3min	1h
3h	9min	3h
10h	30min	10h
30h	90min	30h
1d	72min	1d
3d	216min	3d
10d	12h	10d
30d	36h	30d

3. Indicators

Green LED ON:	indication of supply voltage
Green LED flashes:	indication of time period
Yellow LED ON/OFF:	indication of relay output

4. Mechanical design

Self-extinguishing plastic housing, IP rating IP40
 Mounted on DIN-Rail TS 35 according to EN 50022
 Mounting position: any. Shockproof terminal connection according to VBG 4 (PZ1 required), IP rating IP20
 Tightening torque: max. 1Nm
 Terminal capacity:
 1 x 0.5 to 2.5mm² with/without multicore cable end
 1 x 4mm² without multicore cable end
 2 x 0.5 to 1.5mm² with/without multicore cable end
 2 x 2.5mm² flexible without multicore cable end

5. Input circuit

Supply voltage:
12 to 400V AC

Tolerance:
 Rated frequency:
 Rated consumption:
 Duration of operation:
 Reset time:
 Residual ripple for DC:
 Drop-out voltage:
 Overvoltage category:
 Rated surge voltage:

terminals A1-A2 (galvanically separated)
 selectable via power modules TR2
 according to specification of power module
 according to specification of power module
 2VA (1.5W)
 100%
 100ms
 -
 >30% of the supply voltage
 III (according to IEC 60664-1)
 4kV

6. Output circuit

2 potential free change-over contacts
 Rated voltage: 250V AC

Switching capacity (distance <5mm): 750VA (3A / 250V AC)
 Switching capacity (distance >5mm): 1250VA (5A / 250V AC)

Fusing: 5A fast acting
 Mechanical life: 20 x 106 operations
 Electrical Life: 2 x 105 operations
 at 1000VA resistive load
 Switching frequency: max. 60/min at 100VA resistive load
 max. 6/min at 1000VA resistive load
 (according to IEC 947-5-1)
 Overvoltage category: III (according to IEC 60664-1)
 Rated surge voltage: 4kV

7. Control contact

Activation: bridge Y1-Y2
 Potential free: yes, basic isolation against input and output circuit
 Loadable: no
 Control voltage: max. 5V
 Short circuit current: max. 1mA
 Line length: max. 10m
 Control pulse length: min. 50ms

8. Remote potentiometer (not included)

The internal potentiometer is de-activated when a remote potentiometer is connected !!!
 Connections: 1MΩ potentiometer (type RONDO R2), terminals Z1-Y2
 Line type: twisted pair
 Control voltage: max. 5V
 Short circuit current: max. 5µA
 Line length: max. 5m

Technical data

9. Accuracy

Base accuracy:	±1% (of maximum scale value) using 1MΩ remote potentiometer
Frequency response:	-
Adjustment accuracy:	≤5% (of maximum scale value) using 1MΩ remote potentiometer
Repetition accuracy:	<0.5% or ±5ms
Voltage influence:	-
Temperature influence:	≤0.01% / °C

10. Ambient conditions


Ambient temperature:	-25 to +55°C (according to IEC 68-1) -25 to +40°C (according to UL 508)
Storage temperature:	-25 to +70°C
Transport temperature:	-25 to +70°C
Relative humidity:	15% to 85% (according to IEC 721-3-3 class 3K3)
Pollution degree:	3 (according to IEC 664-1)
Vibration resistance:	10 to 55Hz 0.35mm (according to IEC 68-2-6)
Shock resistance:	15g 11ms (according to IEC 68-2-27)

Functions

The internal potentiometer is de-activated when a remote-potentiometer is connected ! The function has to be set before connecting the relay to the supply voltage.


ON delay (E11)

When the supply voltage U is applied, the instantaneous contact switches into on-position and the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated) the delayed contact switches into on-position (yellow LED illuminated). This status remains until the supply voltage is interrupted. If the supply voltage is interrupted before the expiry of the interval t, the interval already expired is erased and is restarted when the supply voltage is next applied.

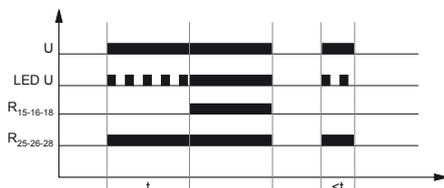

OFF delay with control contact (R11)


The supply voltage U must be constantly applied to the device (green LED illuminated). When the control contact Y1-Y2 is closed, both contacts switch into on-position (yellow LED illuminated). If the control contact is opened, the instantaneous contact switches into off-position and the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated) the delayed contact switches into off-position (yellow LED not illuminated). If the control contact is closed again before the interval t has expired, the interval already expired is erased and is restarted with the next cycle.

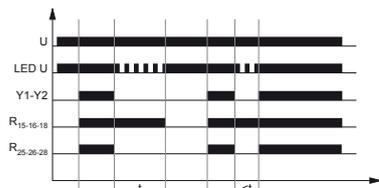

ON delay with control contact (Es11)


The supply voltage U must be constantly applied to the device (green LED illuminated). When the control contact Y1-Y2 is closed, the instantaneous contact switches into on-position and the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated) the delayed contact switches into on-position (yellow LED illuminated). This status remains until the control contact is opened again.

If the control contact is opened before the interval t has expired, the interval already expired is erased and is restarted with the next cycle.

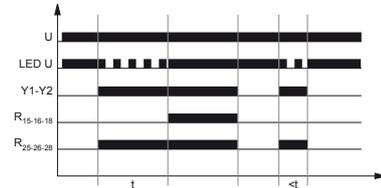


Single shot leading edge voltage controlled (Wu11)

When the supply voltage U is applied, both contacts switch into on-position (yellow LED illuminated) and the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated) the delayed contact switches into off-position (yellow LED not illuminated). This status remains until the supply voltage is interrupted. If the supply voltage is interrupted before the interval t has expired, the both contacts switch into off-position. The interval already expired is erased and is restarted when the supply voltage is next applied.

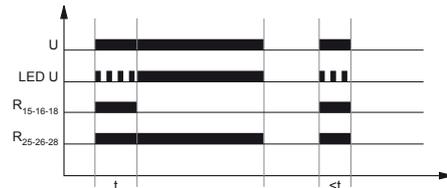

Single shot leading edge with control contact (Ws11)


The supply voltage U must be constantly applied to the device (green LED illuminated). When the control contact Y1-Y2 is closed, both contacts switch into on-position (yellow LED illuminated) and the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated) the delayed contact switches into off-position (yellow LED not illuminated). The instantaneous contact remains in on-position, until the control contact is opened again. During the interval, the control contact (and the instantaneous contact) can be operated any number of times. A further cycle can only be started when the cycle run has been completed.

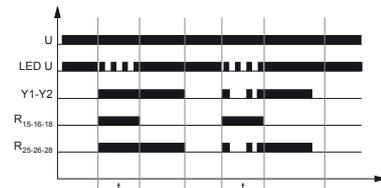

Functions


Single shot trailing edge with control contact (Wa11)

The supply voltage U must be constantly applied to the device (green LED illuminated). When the control contact Y1-Y2 is closed the instantaneous contact switches into on-position. When the control contact is opened, the instantaneous contact switches into off-position, the delayed contact switches into on-position (yellow LED illuminated) and the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated), the delayed contact switches into off-position (yellow LED not illuminated). During the interval, the control contact (and the instantaneous contact) can be operated any number of times. A further cycle can only be started when the cycle run has been completed.

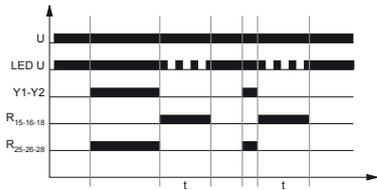


Flasher pulse first (B111)

When the supply voltage U is applied, the instantaneous contact and the delayed contact switch into on-position (yellow LED illuminated) and the set interval t begins (green LED flashes). After the interval t has expired, the delayed contact switches into off-position (yellow LED not illuminated) and the set interval t begins again. The delayed contact is triggered at a ratio of 1:1 until the supply voltage is interrupted.

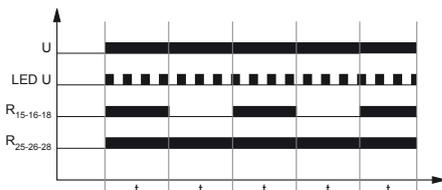


Flasher pause first (Bp11)

When the supply voltage U is applied, the instantaneous contact switches into on-position and the set interval t begins (green LED flashes). After the interval t has expired, the delayed contact switches into on-position (yellow LED illuminated) and the set interval t begins again. After the interval t has expired, the delayed contact switches into off-position (yellow LED not illuminated). The delayed contact is triggered at a ratio of 1:1 until the supply voltage is interrupted.

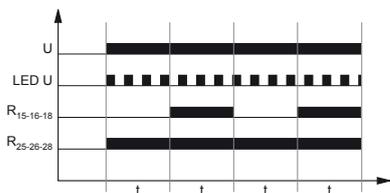


ON delay (E20)

When the supply voltage U is applied, the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated) the output relay R switches into on-position (yellow LED illuminated). This status remains until the supply voltage is interrupted. If the supply voltage is interrupted before the expiry of the interval t, the interval already expired is erased and is restarted when the supply voltage is next applied.

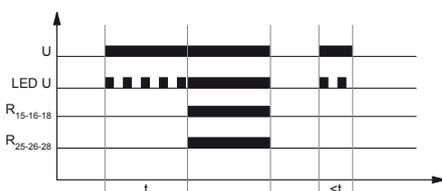


OFF delay with control contact (R20)

The supply voltage U must be constantly applied to the device (green LED illuminated). When the control contact Y1-Y2 is closed, the output relay R switches into on-position (yellow LED illuminated). If the control contact is opened, the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated) the output relay switches into off-position (yellow LED not illuminated). If the control contact is closed again before the interval t has expired, the interval already expired is erased and is restarted with the next cycle.

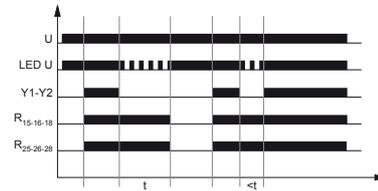


ON delay with control contact (Es20)

The supply voltage U must be constantly applied to the device (green LED illuminated). When the control contact Y1-Y2 is closed, the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated) the output relay R switches into on-position (yellow LED illuminated). This status remains until the control contact is opened again. If the control contact is opened before the interval t has expired, the interval already expired is erased and is restarted with the next cycle.

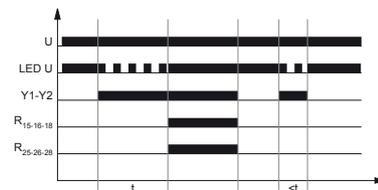


Single shot leading edge voltage controlled (Wu20)

When the supply voltage U is applied, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated) the output relay switches into off-position (yellow LED not illuminated). This status remains until the supply voltage is interrupted. If the supply voltage is interrupted before the interval t has expired, the output relay switches into off-position. The interval already expired is erased and is restarted when the supply voltage is next applied.

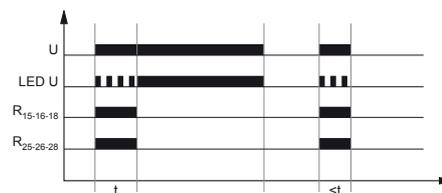

Single shot leading edge with control contact (Ws20)


The supply voltage U must be constantly applied to the device (green LED illuminated). When the control contact Y1-Y2 is closed, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated) the output relay switches into off-position (yellow LED not illuminated). During the interval, the control contact can be operated any number of times. A further cycle can only be started when the cycle run has been completed.

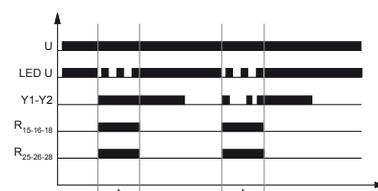

Functions


Single shot trailing edge with control contact (Wa20)

The supply voltage U must be constantly applied to the device (green LED illuminated). Closing the control contact Y1-Y2 has no influence on the condition of the output relay R. When the control contact is opened, the output relay switches into on-position (yellow LED illuminated) and the set interval t begins (green LED flashes). After the interval t has expired (green LED illuminated), the output relay switches into off-position (yellow LED not illuminated). During the interval, the control contact can be operated any number of times. A further cycle can only be started when the cycle run has been completed.

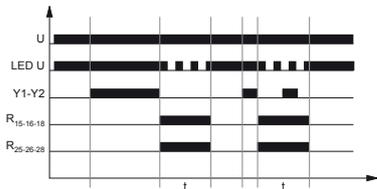


Flasher pulse first (Bi20)

When the supply voltage U is applied, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins (green LED flashes). After the interval t has expired, the output relay switches into off-position (yellow LED not illuminated) and the set interval t begins again. The output relay is triggered at a ratio of 1:1 until the supply voltage is interrupted.

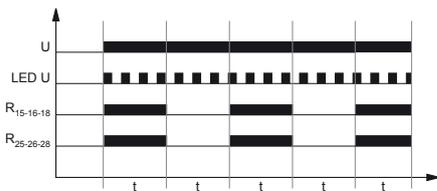


Flasher pause first (Bp20)

When the supply voltage U is applied, the set interval t begins (green LED flashes). After the interval t has expired, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins again. After the interval t has expired, the output relay switches into off-position (yellow LED not illuminated). The output relay is triggered at a ratio of 1:1 until the supply voltage is interrupted.

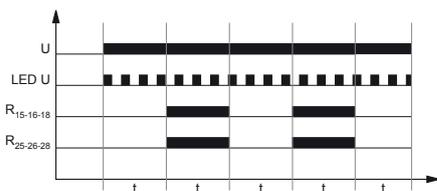

Dimensions

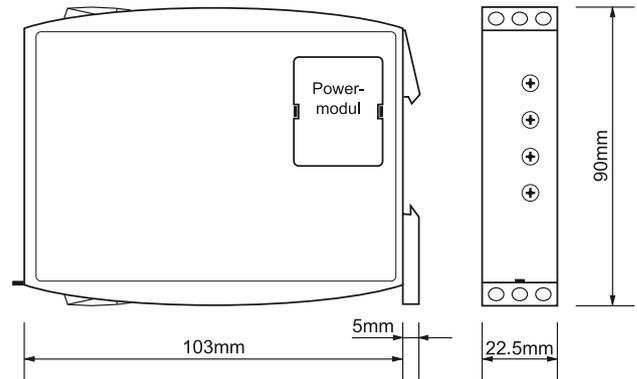

Connections

